# United Enertech

(ENGINEERS) SUBMITTAL DATA

**MODEL S-3V-I** LOW LEAKAGE SMOKE DAMPER

U.L. 555S CLASSIFIED AND ULC S112.1 LISTED

# Class I Leakage Rated

# Application and Design

The Model S-3V-I is a UL/ULC listed and labeled Class I leakage rated Smoke Damper. Blades are of the 3V shaped or crimped design. The damper is approved for airflow in either direction and provides a maximum leakage fo 8 cfm/sq. ft at 4" wg. s.p. It has been designed to be installed in a vertical or horizontal mounting position in the ductwork or a separate sleeve within 24" of the smoke partition. These dampers are approved for use in engineered smoke control systems and are controlled via smoke detection system. Electric (24v, 120v, and 230v) or pneumatic actuators are used to operate the smoke dampers.

## Standard Construction

- Frame: 5" Roll formed Frame Galvanized Steel hat-section W/ staked corners & integral bracing
- Blades: 16 Ga. Roll formed Galvanized Steel 3V Blade Design min. width: 4-1/4" (108mm) max. width: 7-1/4" (184mm)
- Axles: Square plated steel
- Seals: Pressure Sensitive 450° silicone blade edge seals and flexible metal jamb seals.
- Linkage: Concealed in frame. Linkage bars are 1/8" (3.2mm) Bearings: Bronze Oilite press-fit into frame

Designed and tested in accordance to standards: UL 555S, ULC S112.1. Labeled and listed by UL/ULC under File # R25410. They meet all the NFPA-90A, IBC Code, and other major code requirements for Smoke Dampers.

Note: Due to continuing research, UE reserves the right to change specifications without notice


Standard Sizes			
Min. V or H	Max. Single Section	Max. Multiple Assembly	
8" X 6" 203mm X 152mm	36"W X 48"H 914mm X 1219mm	144"W X 96"H 3657mm X 2438mm	

Suggested Specification Low Leakage Smoke Control Dampers shall be Model:S-3V-I by United Enertech. Double blade edge and jamb seals shall be of the pres-sure sensitive type for low leakage. Dampers shall be rated for leakage as to U.L. 555S / U.L.C. S112.1 rating and shall be Class I with leakage not to exceed 8 cfm per sg. ft, at 4.0 inches static pressure. Linkage shall be of the concealed type for the maximum free area.


### Manufacturer's Recommendations

All moving parts of the damper must be inspected and cycled at intervals not greater than every 12 months or in accordance with the latest edition of NFPA 90A, 92A, local codes and the actuator manufacturer. In addition, the damper and inspected for corrosion. Dry lubricants are recommended.

Job Name:	MODEL S-3V-I			
Location:				
Architect:				
Engineer:	DRAWN BY: MAB	DATE: 11-07-07	REV. DATE: 07-10-08	
Contractor:	REV. NO. 3	APPROVED BY: SDC	DWG. NO.: <b>C-1</b>	

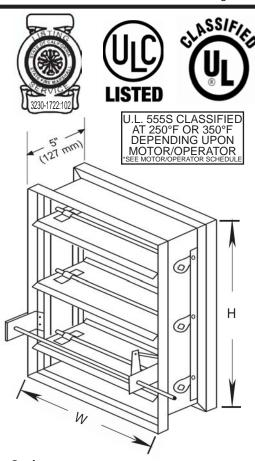

## **Options:**



Notes:

•Non-sleeved and side plated dampers are furnished approximately 1/4" (6.4mm) smaller than given duct dimensions. Sleeved dampers are furnished approx. same size as given duct dimension, unless otherwise noted.

· Not recommended with blades running vertically.



# MODEL S-3V-1 LOW LEAKAGE SMOKE DAMPER U.L. 555S CLASSIFIED / CLASS I

# PERFORMANCE DATA

Pressure drop testing was done by an independent laboratory to AMCA Standard 500-D, Fig. 5.3 ductwork upstream & downstream.

