



## TYPICAL MOTOR MOUNT LOCATIONS FOR FIRE/SMOKE AND SMOKE DAMPERS

Normal Right Hand Mount - Standard

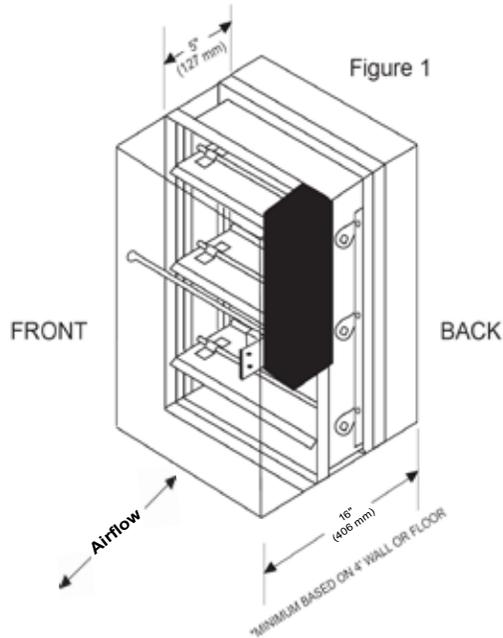

Normal Left Hand Mount

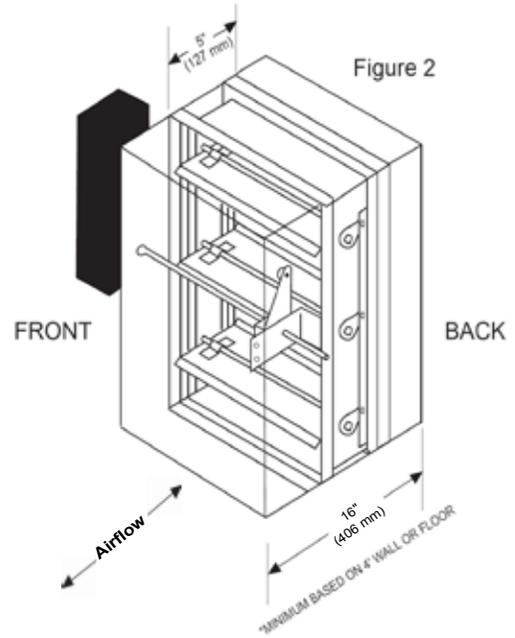

**NOTE:**

1. Appropriate sleeve length is determined by adding 12" to wall or floor thickness, eg. An 8" wall or floor would require a 20" long sleeve.
2. Blade edge seals apply to Class I and II Dampers only.
3. Damper positioning dimensions for all figures are approximately 9-3/8" from and 2-5/8" from back.

**Manufacturer's Recommendations**

All moving parts of the damper must be inspected and cycled at intervals not greater than every 12 months or in accordance with the latest edition of NFPA 90A, 92A, local codes and the actuator manufacturer. In addition, fuse links shall be removed and inspected for corrosion. Dry lubricants are recommended.