


DUCT MOUNTED SMOKE DETECTOR TYPICAL FIRE/SMOKE DAMPER MOUNTING DETAIL

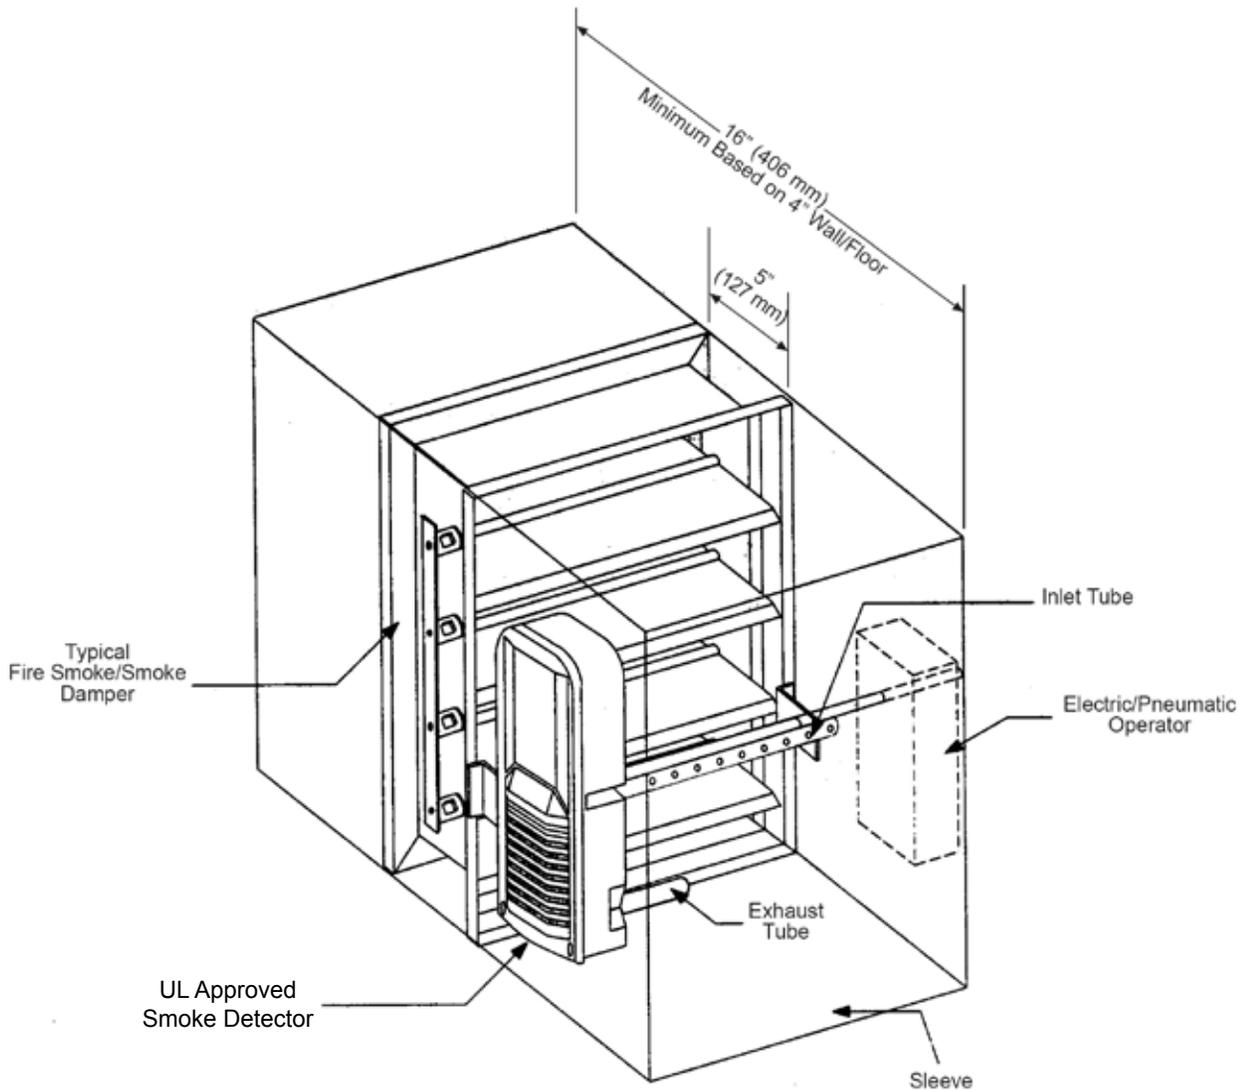

NOTE: Minimum Size 12 x 10

Manufacturer's Recommendations

All moving parts of the damper must be inspected and cycled at intervals not greater than every 12 months or in accordance with the latest edition of NFPA 90A, 92A, local codes and the actuator manufacturer. In addition, fuse links shall be removed and inspected for corrosion. Dry lubricants are recommended.