

Application and Design

The Model FD-110-3V is UL Classified for installation in walls, floors, and partitions with a fire rating of less than 3 hours. This damper may be installed vertically or horizontally in static HVAC systems that shut down in the event of a fire. (See optional 3 hr rating)



Standard Construction

Frame: 5" Roll Formed Frame - Galvanized Steel Hat-section w/ stalked corners & Integral bracing

Blades: 16 Ga. Roll formed - Galvanized steel

min. width 4-1/4" (108mm)

max. width 7-1/4" (184mm)

Axles: square plated steel

Linkage: Concealed in frame. Linkage bars are 1/8" (3.2mm)

Bearings: Bronze Oilite press-fit into frame

Closure Spring: Stainless Steel



Fusible Link - UL-33: UL Listed 165°F (standard), 212°F (optional)

Manual Locking Quadrant- (may be required for inspection)

Options:

- Factory Sleeve: _____ Ga (18 Ga min)
- Sleeve Length: _____ Inches
- Retaining Angles
- EFL (Electric Fusible Link)*
- PFV (Pneumatic Fusible Valve)*
- Out of Wall Const. Available (see dwg. P-36 inst.)
- 3 Hour Rating
- Round Transitions (FDD-110-3V-CR)
- 250° - 350° (Actuator Req.)
- Mounting:
 - Horizontal
 - Vertical

* Option provides quick and economical way to check damper operations and also a Systematic Closure Control. Option PFV allow damper operation without the need/cost for an EP valve and electrical connection at the damper.

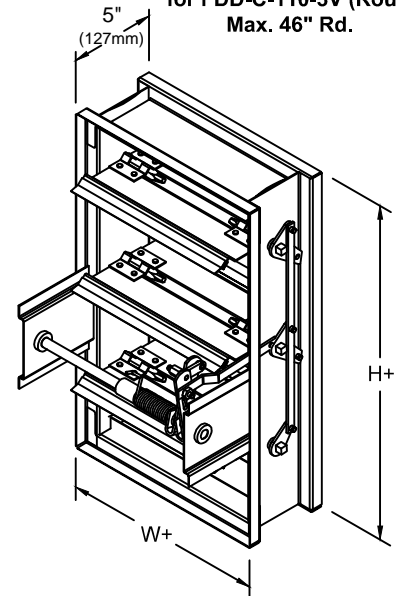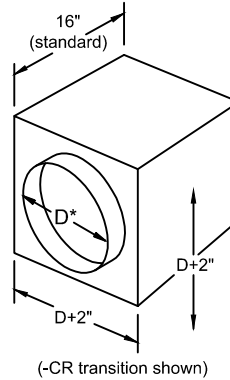

* D= Duct Size Minus 1/4"
* 16"-20 Ga. sleeve required for FDD-C-110-3V (Round)
Max. 46" Rd.

+ Note: Non-sleeved (with side plate) dampers are furnished Approx. 1/4" (6.4mm) smaller than given duct dimensions. Sleeved dampers are furnished Approx. the same size as given duct dimension, unless otherwise noted.

Standard Sizes (Duct) 1-1/2 HR.			
Operator Type	Width	*Max Vertical Size(s)	*Max Horizontal Size
Spring	6" x 6" (152mm x 152mm)	72"w x 48"h (1829mm x 1219mm) 36"w x 96"h (914mm x 2438mm)	72"w x 48"h (1829mm x 1219mm)
Actuator	6" x 6" (152mm x 152mm)	108"w x 96"h (2743mm x 2438mm)	144"w x 96"h (2743mm x 2438mm)
*May consist of multi-sections (Max single section size: 36"w x 48"h (914mm x 1219mm))			

Standard Sizes (Duct) 3 HR.			
Operator Type	Width	*Max Vertical Size(s)	*Max Horizontal Size
Spring	6" x 6" (152mm x 152mm)	72"w x 48"h (1829mm x 1219mm) 36"w x 96"h (914mm x 2438mm)	72"w x 48"h (1829mm x 1219mm)
Actuator	6" x 6" (152mm x 152mm)	72"w x 48"h (1829mm x 1219mm)	72"w x 48"h (1829mm x 1219mm)
*May consist of multi-sections (Max single section size: 36"w x 48"h (914mm x 1219mm))			



Model FD-110-3V meets or complies with the following as a fire damper: All major building codes, including IBC/ICC International Code UL 555 Listing 1-1/2 and 3 hour - File #R25410, ULC S122, NFPA - 90A, 80

Job Name:	<input type="checkbox"/> MODEL FD-110-3V <input type="checkbox"/> MODEL FD-110-3V-OW (Out of Wall) <input type="checkbox"/> MODEL FD-110-3V-CR-R (Round)						
Location:							
Architect:							
Engineer:	<table border="1"> <tr> <td>Drawn By: GAB</td> <td>Date: 11-06-07</td> <td>Rev. Date: 2-13-20</td> </tr> <tr> <td>Rev. No.: 9</td> <td>Approved By: CLJ</td> <td>DWG. No. P-28</td> </tr> </table>	Drawn By: GAB	Date: 11-06-07	Rev. Date: 2-13-20	Rev. No.: 9	Approved By: CLJ	DWG. No. P-28
Drawn By: GAB	Date: 11-06-07	Rev. Date: 2-13-20					
Rev. No.: 9	Approved By: CLJ	DWG. No. P-28					
Contractor:							

Performance Data

AIR FLOW RESISTANCE

Pressure drop test per AMCA Standard 500-D, Figure 5.3.

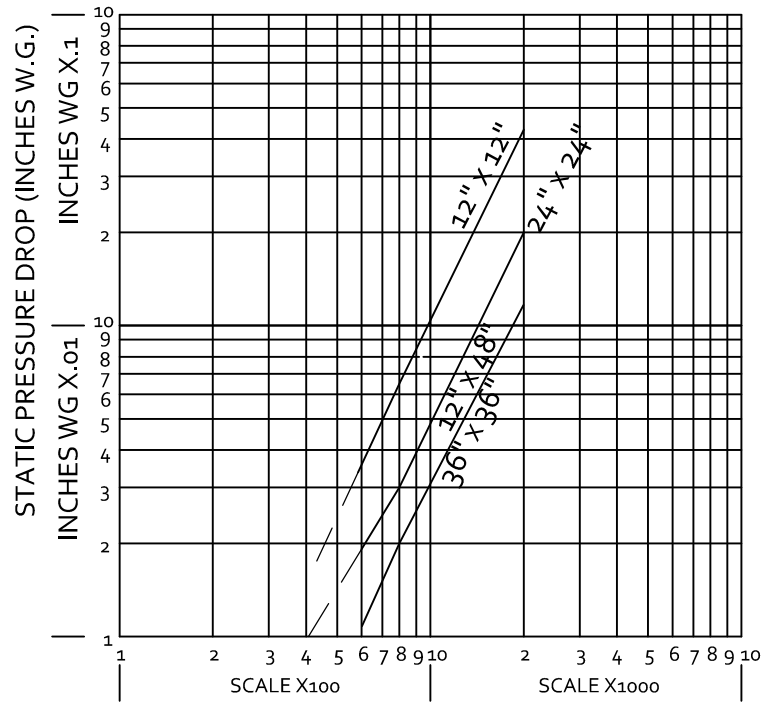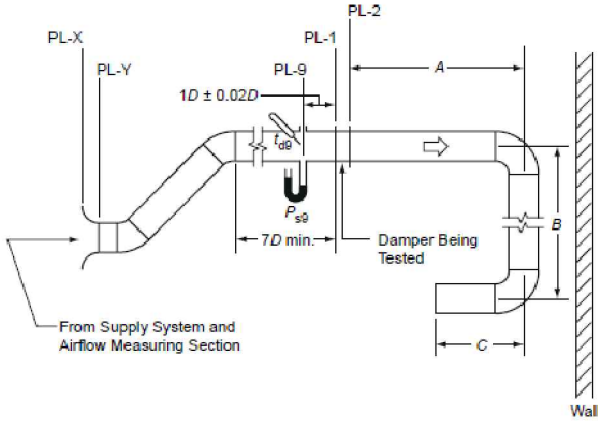

FD-110-3v sizes: 12" x 12", 24" x 24", 48" x 12", 12" x 48", 36" x 36"
 (305 x 305mm, 610 x 610mm, 1219 x 305mm, 305 x 1219mm, 914 x 914mm)
 Data corrected to standard air density

When the actuator is externally mounted and the wall thickness exceeds 5 inches, add 1 inch for each additional inch of wall thickness increased, to ensure sleeve extends through the penetration. As standard the actuator is externally installed on the lower right hand half of the damper when viewed from the jackshaft side. The damper may be installed or rotated 180° such that the actuator will be located on the upper left. The top of the damper is either side of the frame as long as the blades are running horizontal. When ordering internally mounted actuators, be aware there is a min. height requirement (in some cases the sleeve can be increased to allow for internal mounting). The entire damper frame does not have to be installed in the plane of the wall/floor. The rule of thumb is "with the damper in the closed position, the blade plane should be within the plane of the UL rated wall/floor".

