(ENGINEERS) SUBMITTAL DATA

DWG. NO.:

P-42



MODEL F/S-AF-I & F/S-AF-3-I

Combination Fire/Smoke Damper

UL 555 and ULC S112 Listed for 1-1/2 and 3 Hour Rated UL 555S and ULC S112.1 Listed Class I Leakage

Frame: Rollformed galvanized steel hat-section with staked corners and integral bracing. Blades: Airfoil shaped, double skin galv, st. of roll-formed construction. Mechanically joined to form equiv. 14 ga st. Minimum width: 5" (127 mm) Maximum width: 7" (178 mm) Bearings: Bronze Oilite, press-fit into frame. Axles: Square, plated steel. Seals: Pressure sensitive 450°F silicone blade edge seals and flexible metal jamb seals. Linkage: Concealed in frame. Linkage bars are 125" (3.2 mm) thick plated steel. Controlled Closure Device: (Heat Activated) EFL - 165°F Standard, 212°F, 250°F, 350°F available PFL - 165°F Standard, 212°F available *Due to space limitations, Dampers below 12" tall with no sleeve and actuators in the airstream will be equipped with a spring/fuselink assembly in lieu of the EFL temperature response device. Finish: Mill galvanized. Actuator: UL Approved, See Actuator Page, depends on damper size and temperature rating, External or Internal Mounted. m based on 5" wall Maximum Velocity: 2000 fpm (10.2 m/s) on all sizes. 16" minim Maximum Pressure: 4" w.g. (1kPa) Consult Factory for Velocities up to 4000 fpm and 6.0" w.g. Sizes: U.L. 555S Classified at 250°F or 350°F depending upon Minimum Size: 8"w x 8"h (203mm x 203mm)(Ext. Actuator) Jackshaft Actuator/Operator Minimum Size: 10"w x 14"h (254mm x 356mm)(Int. Actuator) See Actuator/Operator Schedule Max: - Single Section: 36"w x 48"h (914mm x 1219mm) Max. - 1-1/2 hr. Vertical: 108"w x 96"h (2743mm x 2438mm) Max. - 1-1/2 hr. Horizontal: 144"w x 96"h (3657mm x 2438mm)* Max. - 3 hr. Vertical: 72"w x 96"h (1828mm x 2438mm) Location Depend On Damper Height, See Chart Max. - 3 hr. Horizontal: 36"w x 48"h (914mm x 1219mm) or Drawing *(May Ship in Multiple Sections for Field Assembly) Note: Due to continuing research, Features: UE reserves the right to change specifications without notice. The F/S-AF-I or F/S-AF-3-I series Combination Fire/Smoke Dampers have been designed and tested to exceed all UL, ULC, and NFPA requirements for fire dampers as well as **Options:** smoke dampers. F/S-AF-I is UL 555 and ULC S112 listed and labeled as an ga. (20 ga minimum). □ Factory sleeves _ 1-1/2 hour rated fire damper. F/S-AF-3-I is UL 555 and ULC S112 listed and labeled as a Lenath inches (min. 16"). (16" x 20 ga side plate provided if no sleeve is indicated, Act. External) 3 hour rated fire damper. UL and ULC listed for both vertical and horizontal mountings. Retaining Angles Smoke Detector UL 555S /ULC S112.1 listed and labeled as a Class I rated One Side Ionization Smoke Damper with airflow in both directions. Class | provides Both Sides Photoelectric for a max. leakage of 8 cfm/sq ft at 4.0" wg static pressure. Notes: □ Transitions Non-sleeved dampers with side plates are furnished approximately 1/4" (6.4 Round □ Micro-Switch Package mm) smaller than given duct dimensions. Sleeved dampers are furnished Remote Control Boxes RCB-1 RCB-2 RCB-3 Oval approximately same size as given duct dimension unless otherwise noted. Not recommended with blades running vertical. Actuator It is recommended the damper must be inspected and cycled at intervals Electric. vac (Voltage) not greater than every twelve months or in accordance with NFPA 80, 90A, Pneumatic, 25 psi 92A, local codes and the actuator manufacturer. Suggested Specifications: Grille Mtg. - 3/4" Mounted Face Flange Combination Fire/Smoke Dampers shall be model: F/S-AF-I or F/S-AF-3-I, by United □ Shipped loose, 1" (if external actuator) Enertech. Fire/Smoke Dampers shall bear the Underwriters Laboratories labels for both Fire Dampers and Smoke Dampers. UL 555S / ULC S112.1 ratings shall be Class I with leakage Mounting Orientation not to exceed 8 cfm per sq ft. at 4.0" static pressure for any size. Linkage shall be of the Vertical Horizontal concealed type for maximum free area. □ MODEL F/S-AF-I (1-1/2 hour) Job Name: Location: □ MODEL F/S-AF-3-I (3 hour) Architect: **REV. DATE:** DRAWN BY: DATE: 11-12-07 2-11-20 GAB Engineer:


REV. NO.

7

Standard Construction:

Contractor:

UL File No. R25410

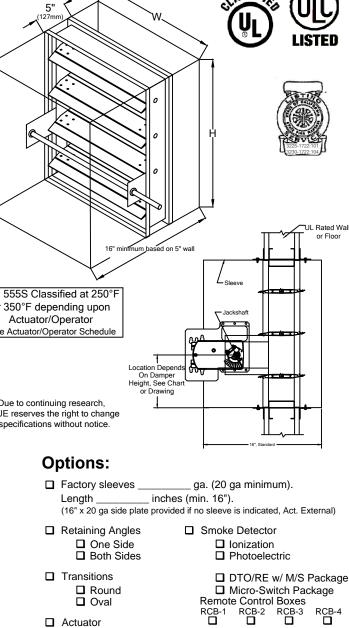

APPROVED BY:

CLJ



MODEL F/S-AF-I & F/S-AF-3-I Combination Fire/Smoke Damper

11/


eak

Retaining Angle

UL 555 and ULC S112 Listed for 1-1/2 and 3 Hour Rated UL 555S and ULC S112.1 Listed Class I Leakage


Performance Data

Pressure drop testing was done by an independent laboratory to the AMCA Standard 500-D, Fig. 5.3 ductwork upstream and downstream.

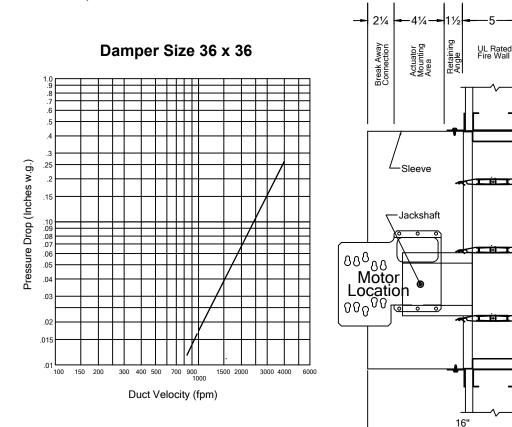

When the actuator is externally mounted and the wall thickness exceeds 5 inches, add 1 inch for each additional inch of wall thickness increased, to ensure sleeve extends through the penetration. As standard the actuator is externally installed on the lower right hand half of the damper when viewed from the jackshaft side. The damper may be installed or rotated 180° such that the actuator will be located on the upper left. The top of the damper is either side of the frame as long as the blades are running horizontal. When ordering internally mounted actuators, be aware there is a min. height requirement (in some cases the sleeve can be increased to allow for internal mounting). The entire damper frame does not have to be installed in the plane of the wall/floor. The rule of thumb is "with the damper in the closed position, the blade plane should be within the plane of the UL rated wall/floor".

Damper Size 24 x 24

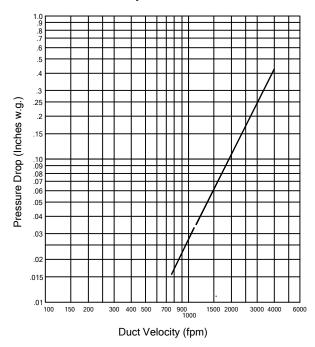

Damper Size 12 x 12

Standard

